

**Side-By-Side Evaluation of a Stressed-Skin Insulated-Core Panel House and a  
Conventional Stud-Frame House**

Armin Rudd  
Subrato Chandra

•

Florida Solar Energy Center  
300 State Road 401  
Cape Canaveral, FL 32920  
407-783-0300

June 1993

## Abstract

Side-by-side energy testing and monitoring was conducted on two houses in Louisville, KY between 12 January 1993 and 5 March 1993. Both houses were identical except that one house was constructed with conventional U.S. 2x4 studs and a truss roof while the other house was constructed with stress-skin insulated core panels for the walls and second floor ceiling. Air-tightness testing included fan pressurization by blower door, hour long tracer tests using sulphur hexafluoride, and two-week long time-averaged tests using perfluorocarbon tracers. While both houses were considered to be more air-tight than average houses in the Louisville area, an average of all the air-tightness test results showed the SSIC panel house to have 30 percent less air infiltration than the frame house. Air-tightness testing resulted in a recommendation that both houses have a fresh air ventilation system installed to provide 0.35 air changes per hour continuously. Thermal insulation quality testing was by infrared imaging. Only two notable defects were found; both were in the frame house. Approximately 6 ft<sup>2</sup> of ceiling insulation was missing over the stairwell and air leakage was observed where a bathroom exhaust duct penetrated the band joist. Pressure differential testing resulted in recommendations to use sealed combustion appliances, and to allow for more return air flow from closed rooms. This can be accomplished by separate return ducts or transfer ducts which simply connect closed rooms to the main body with a short duct. By calculation, the conductive building load coefficient (UA) was within 2 percent for each house. When blower door results for infiltration were included, the total UA was within 7 percent. The SSIC house UA was lower in both cases. By measurement, co-heating tests showed the SSIC panel house total UA to be 12 percent lower than the frame house. Short-term energy monitoring was also conducted for the two houses. A 17 day period of electric heating and a 14 day period of gas furnace heating was evaluated. Monitoring results showed energy savings for the panel house to be 12 percent during electric heating and 15 percent during gas heating. A comparison of the two monitoring periods showed that the lumped efficiency of the gas furnace and air distribution system for both houses was close to 80 percent, which was the same as the manufacturers listed Annual Fuel Utilization Efficiency. Simple regression models using Typical Meteorological Year weather data gave a preliminary prediction of seasonal energy savings between 14 and 20 percent. More accurate seasonal predictions will require additional effort. In addition to the SSIC panel house having less building air leakage, there seem to be other factors, which remain unaccounted for, which cause the panel house to use less heating energy. These factors require further investigation.

## Introduction

A side-by-side evaluation was conducted to assess the heating energy-use benefits of using stressed-skin insulated-core (SSIC) panels in residential construction in Louisville, KY, U.S.A. One house was constructed as a conventional U.S. 2x4 stud-frame, and the other was constructed with SSIC panels. The SSIC wall panels were 4 feet wide by 8 feet high and 2x4 lumber was used for the vertical spline. The SSIC ceiling panels were 4 feet wide by 16 feet long and 2x8 lumber was used for the spline. Both houses were constructed by the same builder who has experience with both types of construction. Each two-story house has 1200 ft<sup>2</sup> floor area and has the same floor plan, elevations, orientation, and nearly the same exterior colors. Both houses are heated by natural gas furnace. All the air distribution ducts are within the thermal envelope of the building. A comparison of the basic building parameters for the two houses is given in Table 1. Energy testing, and unoccupied monitoring with simulated occupancy, was conducted from January 12 through March 5, 1993.

**Table 1**  
**Thermal Envelope Parameters of the Stud-Frame (SF) and Stressed-Skin Insulated-Core (SSIC) Panel houses**

Component	House Type	Construction Type	Insulation
Foundation	Both	Block stem wall and slab	R-10 to 2 foot depth
Walls	SF	2x4 stud	R-13 fiberglass batt Partial R-3.5 sheathing
	SSIC	3-5/8" EPS core panel	R-14 EPS core
Windows	Both	Double glazed, wood frame, aluminum cladding	R-2.0
Second floor ceilings	SF	2x4 truss	R-30 loose-fill cellulose
	SSIC	Flat, 7-3/8" EPS core panel	R-29 EPS core

Both houses were designed to have a conductive thermal transmittance (UA) equal to each other. Calculations, using the as-built configuration and thermal transmission data from (ASHRAE 1989),

show that the SSIC panel house conductive UA equals 265 Btu/hr-°F and the frame house conductive UA equals 271 Btu/hr-°F, a difference of only 2%.

Five days of building diagnostics testing was performed on each house. The testing assessed thermal insulation quality by infrared imaging, building envelope and air distribution system air-tightness by fan pressurization and tracer gas, pressure effects inside the house due to interactions of the air distribution system, calculated versus measured building load coefficients by co-heating, and building thermal capacitance by cool-down.

**Table 2**  
**Measurements Made During House Monitoring**

Measurement Channel	Location and/or Purpose	Sensor
Air temperature	First floor living area, 4 foot height in open air	Type T thermocouple
Mean radiant temperature	First floor living area, 4 foot height in open air	Type T thermocouple
Relative humidity	First floor living area, 4 foot height in open air	Bulk polymer, resistive
Wall surface temperature	First floor living area, 4 foot height on south wall, not over framing member	Type T thermocouple
Air temperature	Second floor hall, 6 foot height in open air	Type T thermocouple
Air Infiltration	First and second floors, open air	Passive perfluorocarbon tracer (PFT's)
Gas energy-use	Natural gas consumption by furnace	Gas meter with electronic output
Electric energy-use	Heater on dedicated circuit for simulated internal gains	Watt-hour monitor
Electric energy-use	Whole house electric use monitored at load center	Watt-hour monitor

Four weeks of short-term energy-use monitoring was conducted -- two weeks of electric heating energy-use monitoring and two weeks of gas heating energy-use monitoring. The houses were unoccupied during monitoring but internal heat gains due to people and equipment were simulated by computer control. The internal gain profile was taken from a study conducted in the Northwest for the Bonneville Power Administration by the Pacific Northwest Laboratories (Pratt 1989). In addition to house energy-use data, data from house dry bulb temperature, mean radiant temperature, south wall surface temperature, and relative humidity were continuously monitored. The monitoring plan is described in Table 2. In order to increase measurement accuracy, all thermocouples were made from special calibration wire from the same spool. Passive perfluorocarbon tracer gas sources and samplers were deployed to measure the time-averaged house air exchange rates (Dietz 1986). A weather measurement station was installed on top of one of the houses and continuously monitored the channels listed in Table 3. A photograph of the two houses, with the weather station on top of the SSIC panel house, is shown in Figure 1.

**Table 3**  
**Weather Station Measurements**

Measurement Channel	Sensor
Radiation shielded air temperature	Type T thermocouple
Relative humidity	Bulk polymer, resistive
Vertical solar irradiance	Silicon pyranometer
Horizontal solar irradiance	Silicon pyranometer
Wind speed	Helicoid propeller anemometer
Wind direction	Lightweight vane




**Figure 1** Photograph of the two test houses; weather station installed on top of the SSIC panel house on the right. The middle house separates the two test houses and was not part of the test.

### **Results - Energy Testing/Building Diagnostics**

Infrared scanning indicated that the thermal insulation quality of both houses was good. Few defects were found which would have a significant impact on energy use. The stud-frame house had two insulation defects that are worth noting. One defect involved a ceiling area over the stairwell, approximately 6 ft<sup>2</sup>, where the blown-in insulation was missing. The other defect became apparent only after infiltration was forced by the blower door - an air leak occurred where the exhaust duct in the first floor bathroom penetrated the band joist and was not completely sealed. Examination of a photograph of that same penetration, taken during construction, revealed that a worker had attempted to seal the gap, but he did not get it sealed well enough. These defects were not fixed.

Air-tightness was evaluated for the building envelopes and the air distribution systems. Blower door and tracer gas tests indicated that the envelope of the SSIC panel house was more air-tight. The tracer gas tests, using SF<sub>6</sub> and a specific vapor analyzer, showed that both houses had an increase in air infiltration when the air distribution system was operating. However, duct leakage to the outdoors was less than the blower door could measure accurately. Figure 2 gives a summary of these results. Also included in Figure 2 are results from the perfluorocarbon tracer (PFT) time-averaged infiltration measurements taken during the electric and gas heating monitoring periods. The averaging period was 17 days for electric heating and 21 days for gas heating. PFT results showed higher infiltration for the frame house compared to the panel house

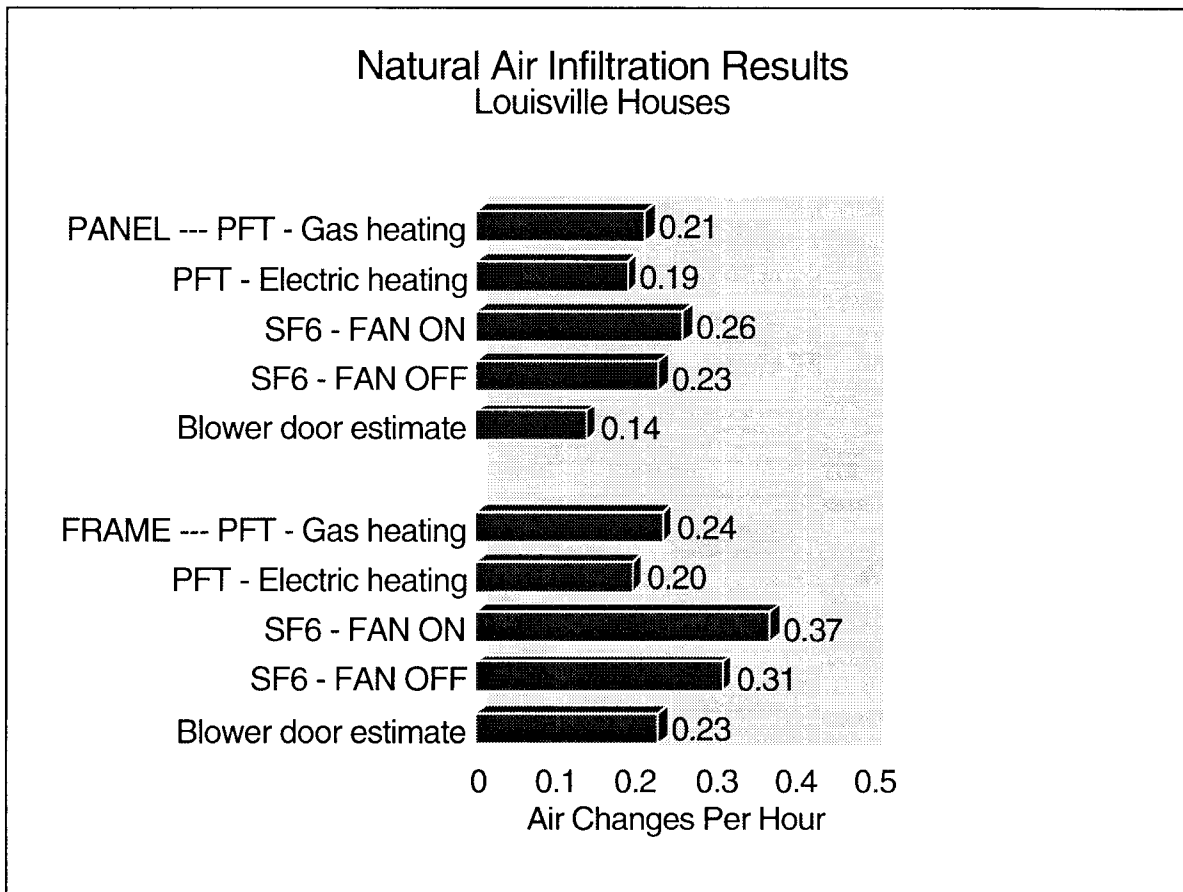


**Figure 2** Natural air infiltration results - blower door estimate and tracer gas

and higher infiltration for the gas heating monitoring period compared to the electric heating monitoring period. During the gas heating period, the influence of the naturally aspirated (not sealed combustion) furnace, and the movement of air by the air distribution system, may have contributed to higher infiltration. The average outdoor temperature during the gas heating period was about 6.5°F lower which may have driven more stack-effect infiltration. The wind speed was

similar for both periods. Because of the variation in natural air infiltration, as measured by the three methods, the results are somewhat inconclusive in an absolute sense, however, they are consistent in a relative sense in that the panel house was always tighter and air infiltration was always greater when the furnace fan was operating. Both houses were considered to be much more air-tight than average houses in the Louisville area, an average of all the air-tightness test results yielded a natural infiltration rate of 0.27 for the frame house and 0.21 for the SSIC panel house. Recommendations from the American Society of Heating Refrigerating and Air-Conditioning Engineers (ASHRAE), in their Standard 62-1989, indicate that houses should have at least 0.35 air changes per hour or 15 ft<sup>3</sup>/min of ventilation air per occupant. Based on that, a whole-house fresh air ventilation system should be considered for both the frame and panel houses. For the Louisville climate, an exhaust-only ventilation system providing at least 0.35 air changes per hour, or about 60 ft<sup>3</sup>/min for these particular houses, may be the most cost-effective. This may be accomplished by installing a two speed exhaust fan in the attic which is ducted to each bathroom and to the outdoors. The fan could run on low speed constantly, and be manually switched to high speed by occupants. A humidistat control could also be linked to the high speed mode. A 100 ft<sup>3</sup>/min, 48 W fan would use about 420 kW-hr per year to operate continuously. At \$0.08/kW-hr the cost would be \$34/yr. Many people have questioned why it is recommended to seal a house tightly and then install a fan to ventilate it. The answer is that relying on random leaks in the building and unknown pressure forces due to wind and temperature does not assure adequate ventilation at all times, and it may lead to over-ventilation and high energy bills. In addition, leaky duct systems, in certain instances, can cause pressure imbalances which can cause combustion appliances to malfunction. This can lead to health and safety problems.


A series of measurements were taken to evaluate pressure differentials within the building, and between the building interior and the outdoors. The impact of building pressure differentials can affect occupant health and safety, building durability, and energy-use. Since both houses have gas furnaces inside the conditioned space, occupant health and safety could be affected if negative pressures caused the furnaces to back-draft. Pressure measurements taken between the utility closet and the outdoors showed pressures between -2.0 Pa and -5.7 Pa. These measurements were taken with the furnace fan on, and the kitchen and bath exhaust fans on; a clothes dryer, which will be installed inside the house, would have increased the exhaust flow. Since the utility closet has two 6" ducts connecting it to the ventilated attic to provide combustion air and dilution air, a recommendation is made that the utility closet doors be weather stripped to better seal the furnace, and gas hot water heater, from the main body of the house. Or better yet, use sealed combustion appliances. Additional pressure differential measurements taken between closed rooms and the main body of the house, with the furnace fan and exhaust fans on, showed that the main body depressurized to about -5 Pa while the closed rooms pressurized

to between 3 and 10 Pa. These pressure differentials would cause increased infiltration in the main body and increased exfiltration in the closed rooms, resulting in increased energy-use (Cummings 1992). In a cold climate, if warm moist air is forced through the building shell due to pressurized rooms, moisture may condense inside the building shell and cause material degradation. A recommendation is made to allow for more return air flow from closed rooms by separate return ducts or transfer ducts which simply connect closed rooms to the main body with a short duct.

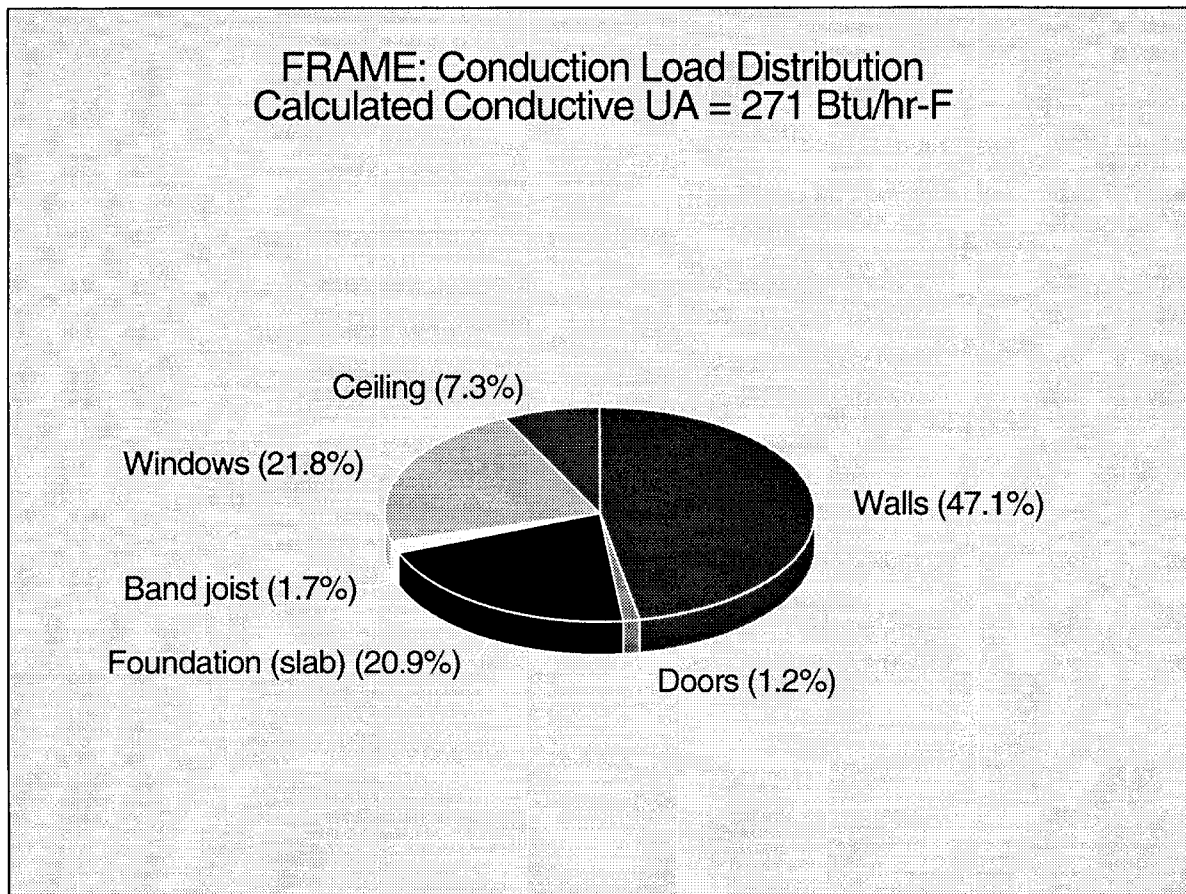

**Figure 3a** Conduction heating load distribution and calculated conductive UA for the stud-frame house

Figure 3a shows the calculated conductive thermal transmittance, or conductive UA, and conduction heating load distribution for the stud-frame house. Figure 3b shows the same for the SSIC panel house. Both houses had nearly the same distribution and the calculated conductive UA's were within 2% of each other - the panel house was lower. When the measured infiltration UA was included, from the blower door results, the total building UA for the panel house was 7%

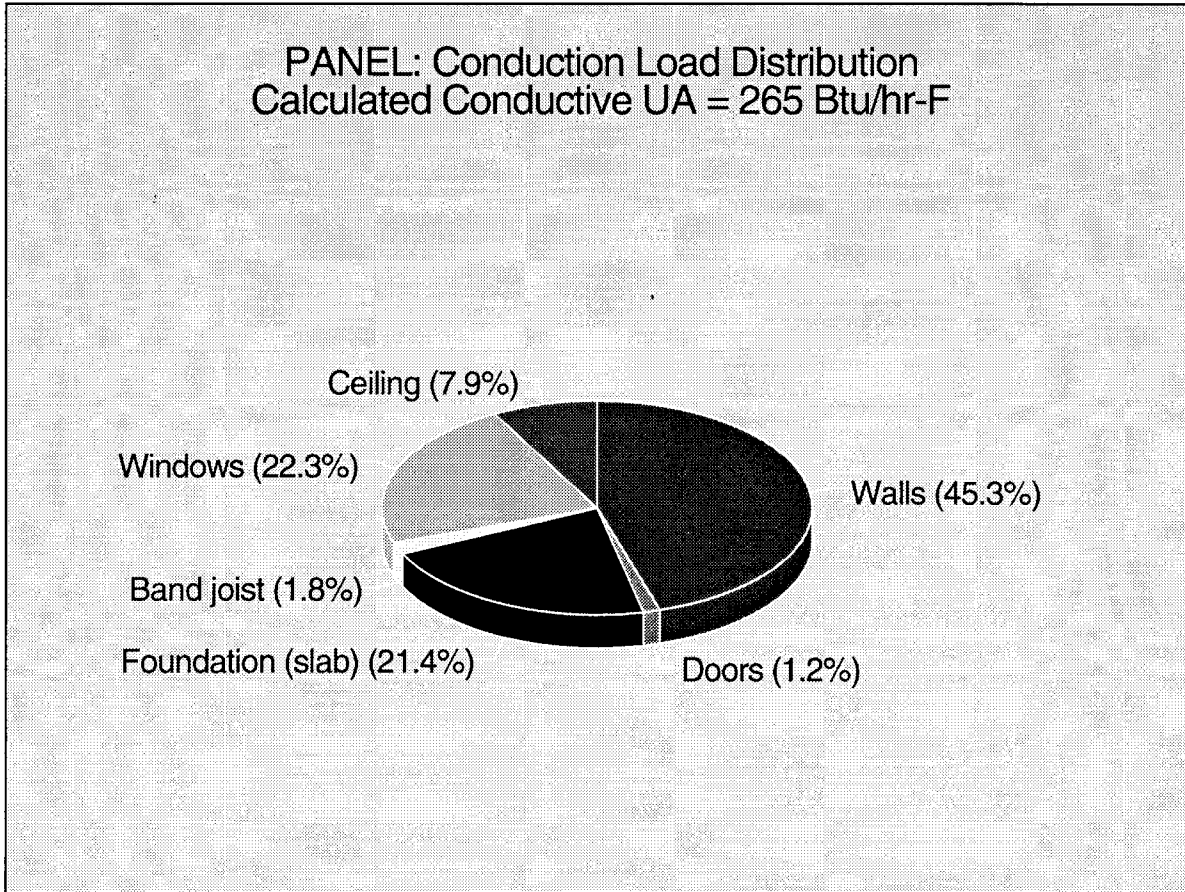

**Figure 3b** Conduction heating load distribution and calculated conductive UA for the SSIC panel house

lower than that of the frame house. In order to determine the as-built total UA, a co-heating test was performed. Figure 4 displays the inside to outside temperature difference of each house and the energy used to hold that temperature. The measured UA for the SSIC panel house was 19% lower than that of the stud-frame house, for the one-night co-heating test. A more accurate estimate of the as-built building UA is presented with the electric heating monitoring results. That UA is calculated by a linear regression of, in effect, 17 nights of co-heating data.

An evaluation of the thermal capacity of each house was made, starting at sundown, by letting the house temperature fall with no internal heat source. The two buildings appear to have nearly the same thermal capacitance. The drop in inside temperature as a function of time is shown for each house in Figure 5. The time constant for the stud-frame house was 8 hours compared to 10 hours for the SSIC panel house. The panel house cooled more slowly since it has a lower heat loss coefficient, and in a follow-on test, where the houses were heated up at the same

energy input rate, the panel house also heated up more quickly due to its lower concurrent heat loss rate.


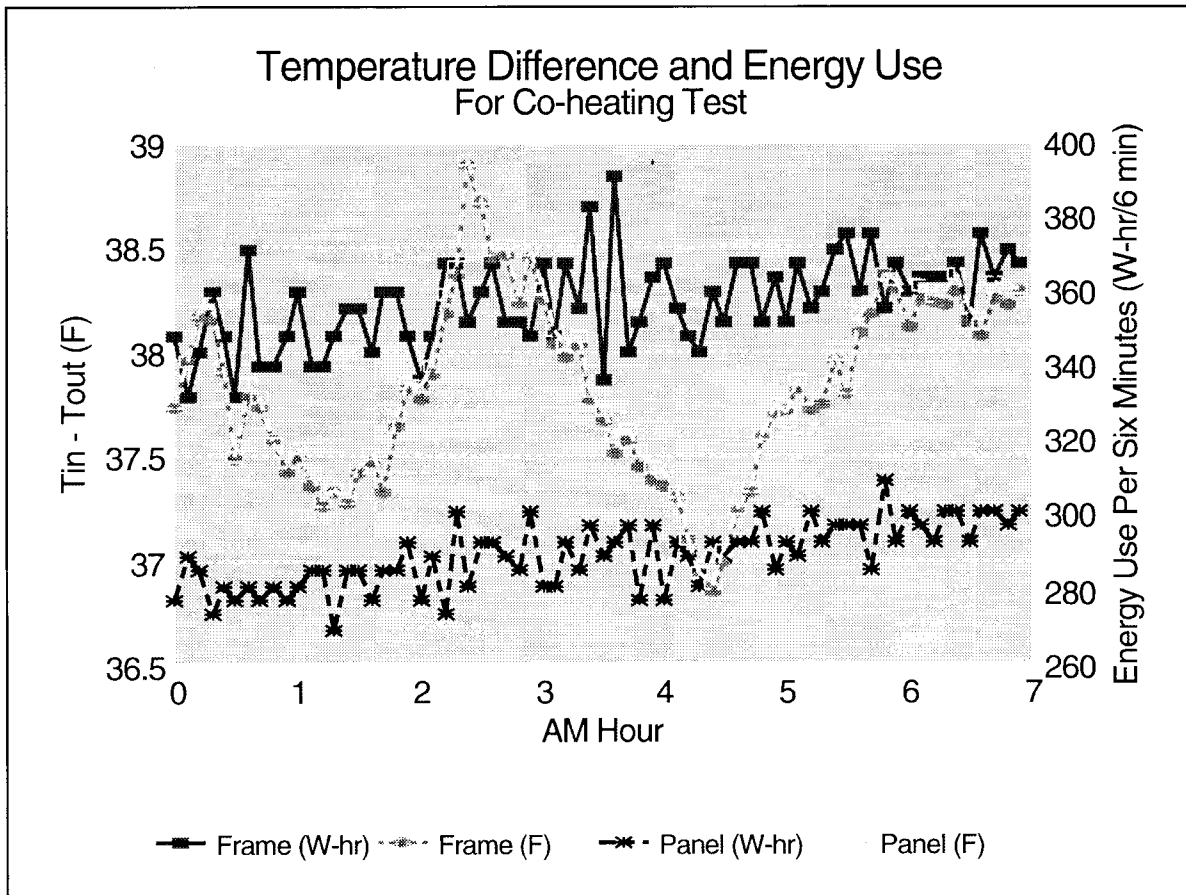



Figure 4 Inside to outside temperature difference and heating energy-use for co-heating test

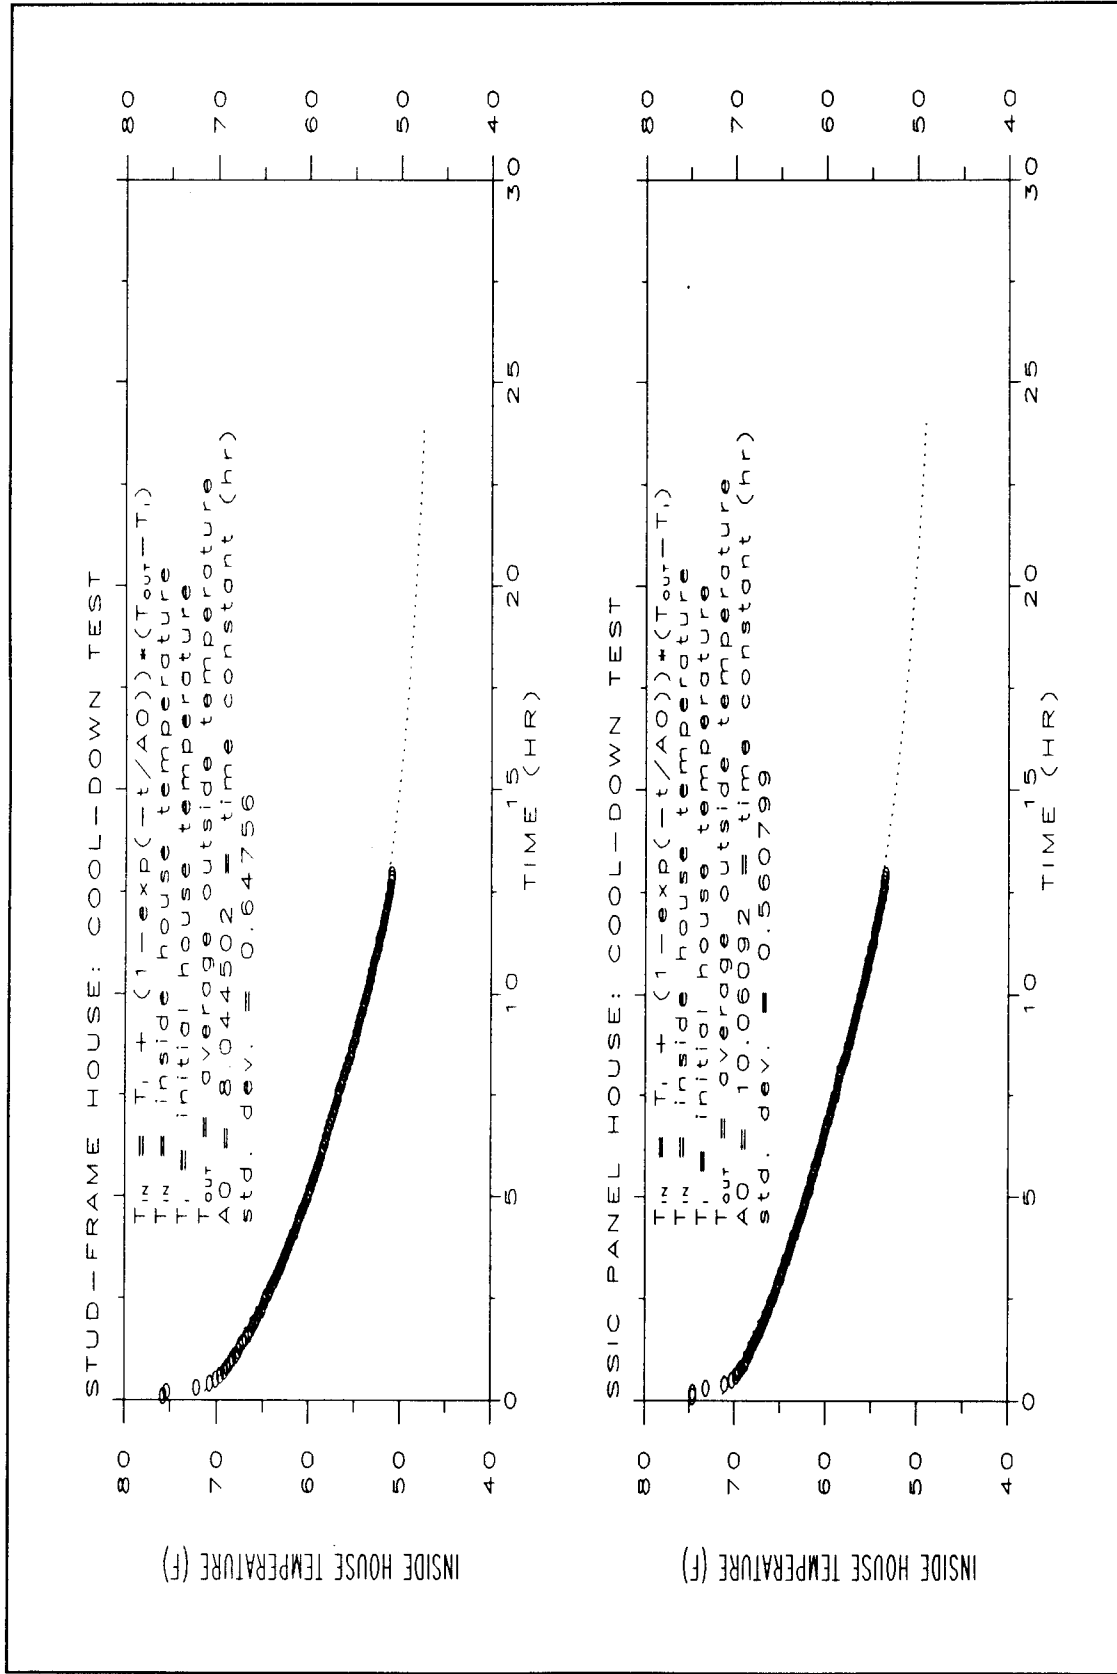

**Figure 5** House temperature decay during thermal capacity cool-down test

## Results - Energy-use Monitoring

Two periods of energy-use monitoring, one for electric heating and one for gas heating, was included in the monitoring plan in order provide a more accurate comparison of the thermal envelopes of the two houses, and to calculate a total heating system and air distribution system efficiency. Electric heating eliminated the additional measurement uncertainties associated with the gas furnace and the increased air infiltration effects and leakage of the air distribution system. Since electric heating efficiency is 100%, the difference in measured building UA between the electric heating and gas heating monitoring should be due mainly to the gas furnace efficiency and infiltration/leakage effects caused by the air distribution system.

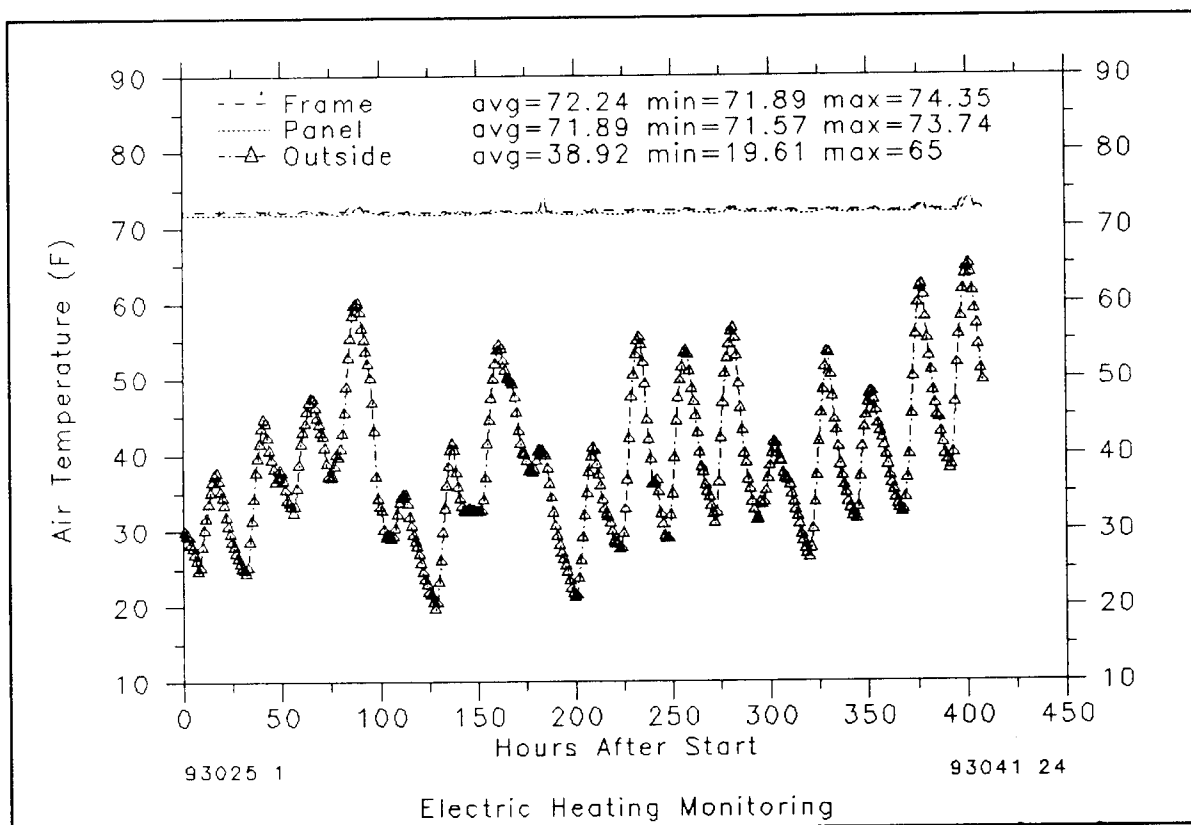

**Figure 6a** Hourly averages of inside temperature for both houses, and outside temperature, during the electric heating monitoring period

A total of seventeen consecutive days of electric heating energy-use monitoring was completed between 25 January and 10 February 1993. The houses were heated with six 1300 W electric heaters placed throughout the house. The heaters were turned on and off by computer control based on temperature feedback from thermocouples. Data was collected every six seconds and




**Table 4a**  
**Daily Summary of House Interior Conditions and Weather Conditions - Electric Heating Monitoring Period**

Day of Electric Monitoring Period	Frame House				Panel House				Frame-Panel Difference				Weather Conditions			
	Tair (F)	Twall (F)	Tmrt (F)	RH (%)	Tair (F)	Twall (F)	Tmrt (F)	RH (%)	Tair (F)	Twall (F)	Tmrt (F)	RH (%)	Tair (F)	RH (%)	WS (mph)	Irr.ver (W/m2)
93025	72.2	68.4	69.8	35.0	71.7	68.2	69.4	36.8	0.5	0.3	0.3	-1.8	31.2	45.0	3.2	118.2
93026	72.2	68.5	69.8	33.5	71.8	68.2	69.4	35.5	0.4	0.3	0.3	-1.9	33.9	42.0	2.5	117.3
93027	72.2	69.2	70.0	34.6	71.9	68.8	69.7	36.4	0.3	0.3	0.3	-1.8	40.2	44.8	3.4	115.6
93028	72.4	69.9	70.5	36.3	72.1	69.4	70.2	38.0	0.3	0.5	0.3	-1.7	48.5	44.0	5.8	110.7
93029	72.1	68.6	69.8	34.6	71.8	68.5	69.7	36.0	0.3	0.1	0.0	-1.5	31.9	41.1	6.3	101.6
93030	72.1	68.3	69.6	30.7	71.8	67.8	69.5	31.8	0.3	0.6	0.2	-1.1	29.8	35.7	4.2	125.9
93031	72.1	69.1	70.1	32.1	71.9	68.5	69.8	32.8	0.2	0.5	0.2	-0.7	43.0	38.9	6.7	110.9
93032	72.3	69.2	70.0	33.0	71.9	68.9	69.9	34.5	0.4	0.3	0.1	-1.5	38.2	42.6	6.9	124.1
93033	72.1	68.4	69.6	29.0	71.7	68.2	69.5	31.2	0.4	0.2	0.1	-2.2	30.3	36.2	4.2	126.3
93034	72.2	69.0	70.0	29.3	71.8	68.8	69.8	31.5	0.4	0.2	0.2	-2.2	39.7	30.6	1.9	108.9
93035	72.2	69.3	70.1	30.3	71.9	69.1	70.0	32.4	0.4	0.2	0.1	-2.1	41.3	35.4	3.2	122.7
93036	72.3	69.3	70.2	30.6	71.9	69.0	70.1	32.7	0.3	0.3	0.1	-2.1	42.9	34.4	1.7	90.6
93037	72.2	68.9	69.9	30.9	71.9	68.5	69.9	32.7	0.3	0.5	0.0	-1.8	36.2	56.5	3.9	78.5
93038	72.2	69.2	70.0	30.7	71.9	69.0	69.9	32.7	0.3	0.2	0.1	-2.0	38.3	50.0	2.1	118.2
93039	72.2	68.8	70.0	31.6	71.9	68.8	70.0	33.7	0.3	0.0	0.0	-2.0	39.7	62.8	2.8	73.7
93040	72.3	69.4	70.4	32.6	72.1	69.4	70.3	34.6	0.3	0.1	0.1	-2.1	45.5	53.2	2.4	93.2
93041	72.7	70.4	71.0	34.4	72.3	70.2	70.8	36.4	0.4	0.3	0.2	-2.1	51.3	49.5	1.9	103.6
averages:	72.2	69.1	70.0	32.3	71.9	68.8	69.9	34.1	0.3	0.3	0.2	-1.8	38.9	43.7	3.7	108.2
maximums:	72.7	70.4	71.0	36.3	72.3	70.2	70.8	38.0	0.5	0.6	0.3	-0.7	51.3	62.8	6.9	126.3
minimums:	72.1	68.3	69.6	29.0	71.7	67.8	69.4	31.2	0.2	0.0	0.0	-2.2	29.8	30.6	1.7	73.7

**Table 4b**  
**Daily Summary of House Interior Conditions and Weather Conditions - Gas Heating Monitoring Period**

Day of Gas Monitoring Period	Frame House				Panel House				Frame-Panel Difference				Weather Conditions			
	Tair (F)	Twall (F)	Tmrt (F)	RH (%)	Tair (F)	Twall (F)	Tmrt (F)	RH (%)	Tair (F)	Twall (F)	Tmrt (F)	RH (%)	Tair (F)	RH (%)	WS (mph)	Irr.ver (W/m2)
93043	72.8	70.2	71.7	34.5	71.3	69.1	70.1	36.7	1.5	1.1	1.6	-2.2	41.3	82.6	4.6	3.7
93044	72.7	69.6	71.5	31.6	70.9	68.5	69.7	34.1	1.7	1.1	1.8	-2.6	33.2	71.8	5.9	7.4
93045	72.8	69.7	71.6	29.5	71.4	68.9	70.1	32.3	1.3	0.8	1.5	-2.8	31.7	62.0	4.7	9.8
93046	73.5	70.2	72.3	27.8	72.1	69.5	70.8	31.4	1.3	0.7	1.5	-3.5	31.7	68.6	2.9	16.0
93047	73.9	70.7	72.7	28.6	72.8	70.3	71.4	31.2	1.1	0.5	1.3	-2.6	33.7	76.8	5.8	12.1
93055	72.4	69.6	70.9	19.7	73.1	70.9	71.3	20.7	-0.7	-1.2	-0.4	-1.1	20.1	38.5	5.3	120.2
93056	72.8	69.3	71.4	18.6	72.9	70.1	71.3	20.3	-0.1	-0.8	0.0	-1.8	23.5	64.6	5.0	19.9
93057	72.6	69.3	71.3	20.4	73.1	70.3	71.6	22.5	-0.5	-1.0	-0.3	-2.2	28.0	74.0	4.7	33.1
93058	72.6	70.4	71.3	19.9	73.3	71.5	71.8	21.7	-0.7	-1.1	-0.5	-1.9	25.2	46.2	2.8	275.7
93059	72.6	70.5	71.3	19.5	73.3	71.6	71.8	21.6	-0.8	-1.1	-0.5	-2.1	27.7	46.9	1.7	275.4
93060	72.5	70.8	71.4	20.4	73.3	71.7	72.0	22.8	-0.8	-0.9	-0.6	-2.4	36.7	48.0	2.1	247.3
93061	72.5	69.8	71.4	23.1	73.2	70.8	71.9	25.8	-0.7	-0.9	-0.5	-2.7	41.6	67.6	1.8	18.0
93062	72.4	69.8	71.2	28.8	73.2	70.9	72.0	29.6	-0.8	-1.1	-0.7	-0.8	45.7	90.0	2.5	13.3
93063	72.3	69.5	71.2	30.2	73.1	70.7	71.8	30.9	-0.8	-1.2	-0.6	-0.6	40.5	85.2	5.9	9.4
averages:	72.7	70.0	71.5	25.2	72.7	70.3	71.3	27.3	0.1	-0.4	0.2	-2.1	32.9	65.9	4.0	75.8
maximums:	73.9	70.8	72.7	34.5	73.3	71.7	72.0	36.7	1.7	1.1	1.8	-0.6	45.7	90.0	5.9	275.7
minimums:	72.3	69.3	70.9	18.6	70.9	68.5	69.7	20.3	-0.8	-1.2	-0.7	-3.5	20.1	38.5	1.7	3.7

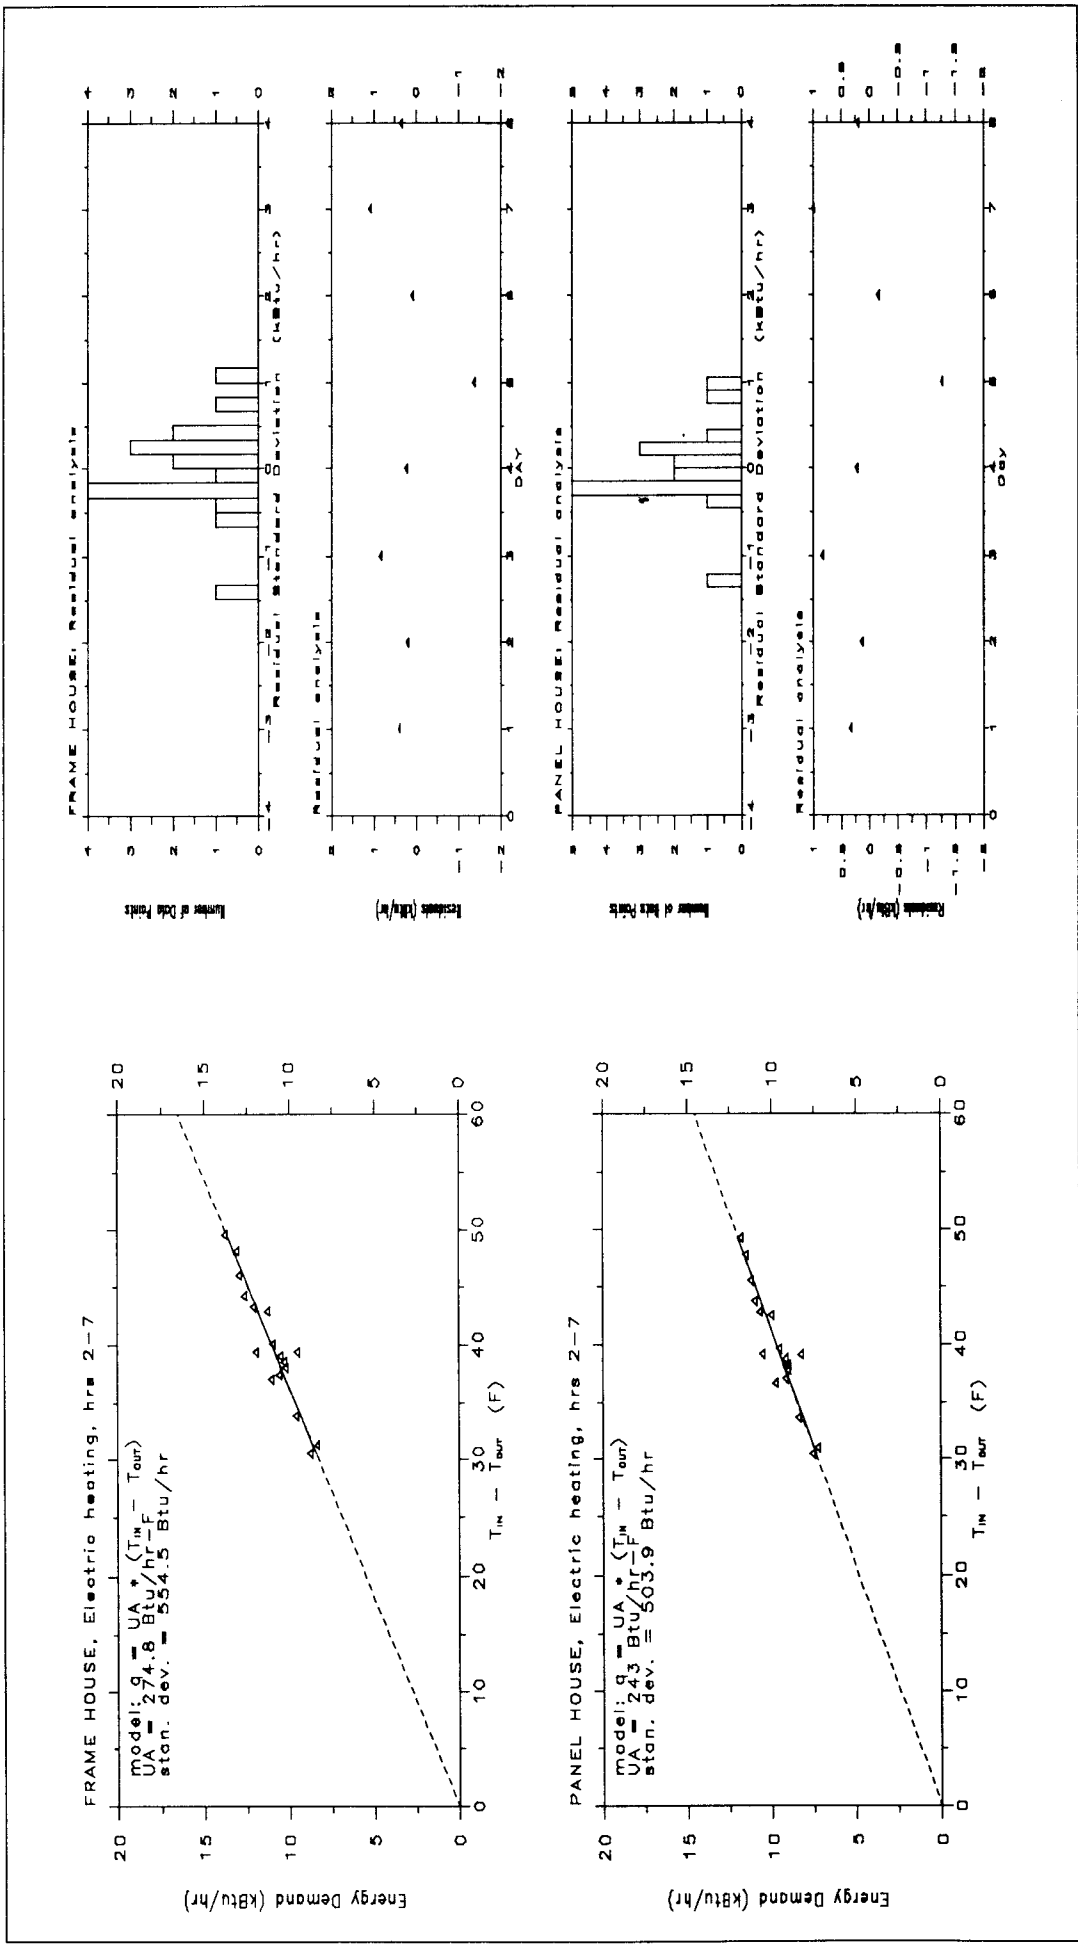

**Figure 7** Linear regression of nighttime (hours 2-7) heating energy-use data as a function of inside to outside temperature difference during the electric heating monitoring period; adjoining residual analysis

Tables 4a and 4b, give a concise summary of the daily-averaged data describing the indoor conditions of the two houses, as well as the differences between the houses, and the outdoor environmental conditions. The differences in air temperature, south wall temperature, and mean radiant temperature were small for both monitoring periods. Relative humidity was about 2% higher in the panel house, well within the sensor accuracy limit of  $\pm 2\%$ .

**Table 5**  
**Measured Building UA and Heating System Efficiency**

	Measured Building UA		Percent Difference
	Frame House	Panel House	
	(Btu/hr-°F)	(Btu/hr-°F)	
Electric heating monitoring (17 nights)	276	242	12.3%
Gas heating monitoring (14 nights)	352	300	14.8%
	Gas furnace and air distribution system efficiency		
	78.4%	80.7	

A linear regression of heating energy-use and inside to outside temperature difference is shown in Figure 7. The objective of the analysis of Figure 7 was to obtain a more accurate estimate of the as-built building UA than the one-night co-heating test could give. Only night hours, hours 2-7, were included in the regression to minimize the effects of solar gains and thermal capacitance. The adjoining residual analysis in Figure 7 shows acceptable normality of distribution and no significant bias error. Table 5 gives a summary of the results for both monitoring periods and the one-night co-heating test. The building UA's of 276 for the frame house and 242 for the panel house are expected to be the most accurate and repeatable results. Taking those UA values, and comparing them to those obtained from the gas heating monitoring period, yields a lumped efficiency for the gas furnace plus the air distribution system leakage and possible infiltration effects due to pressure imbalances. Those efficiencies are 78% and 81% for the frame and panel houses, respectively. Since the gas furnaces have a rated 80% Annual Fuel Utilization Efficiency, it seems that the conclusion from blower door testing, that there was no measurable duct leakage, was confirmed. All interior doors were open during the monitoring

periods, hence there was little opportunity for pressure imbalance which could increase building air leakage.

**Table 6**  
**Heating Energy Savings Of SSIC Panel House Over Stud-frame House**

	Percent Heating Energy Savings
<b><i>Electric Heating Monitoring</i></b>	
Night data	12
Daily data	15
Seasonal predicted	14-16
<b><i>Gas Heating Monitoring</i></b>	
Night data	15
Daily data	17
Seasonal predicted	16-20

Heating energy savings were calculated for both monitoring periods by comparing the total energy consumed by each house, less the internal gains profile. No outside lights were operable, and the gas hot water heaters were turned off, hence, all electricity and gas consumed were considered to contribute to the heating of the houses. Table 6 summarizes the heating energy savings results. The night data, hours 2-7, were expected to give the most accurate comparison of the two building thermal envelopes due to the fact that any solar gain differences between the two buildings would have no impact. Night data showed that the SSIC panel house used between 12 and 15% less heating energy than the stud-frame house. The daily data was considered to give the next level of accuracy and was primarily utilized to obtain a simple mathematical model with which to predict seasonal savings. Daily data (all 24 hours) indicated that the panel house used between 15 and 17% less heating energy. Two mathematical models were calculated by linear regression of the daily heating energy-use data. The first model included only two coefficients:

$$y = a1*(T_{in} - T_{out}) + a2 \quad (1)$$

where:  $y$  = heating energy-use  
 $T_{in}$  = inside temperature  
 $T_{out}$  = outside temperature  
 $a1, a2$  = regression coefficients


The second model included a third coefficient to pick up the impact of solar gain:

$$y = a0*I_{hor} + a1*(T_{in} - T_{out}) + a2 \quad (2)$$


where:  $I_{hor}$  = horizontal solar irradiance

The analysis showed that solar irradiance had almost no impact on heating energy savings during the monitoring periods. This is supported in that the difference in energy savings predicted by both models, using the actual monitored weather data, was less than 0.2%. When the model was used to extrapolate, or predict seasonal energy savings, using Typical Meteorological Year weather data for Louisville, the difference between the models became more significant. The predicted seasonal heating energy savings ranged between 14 and 20% in favor of the panel house. However, the reader is cautioned that the models referred to here may not accurately represent seasonal savings. A more in depth approach, using a detailed energy simulation model which was "tuned" to the actual measured data (Lutz 1992), would be desirable, given additional effort. Another approach could be the Short-Term Energy Monitoring/Primary and Secondary Terms Renormalization (STEM/PSTAR) method developed at the National Renewable Energy Laboratory (Subbarao 1988).

Figures 8a and 8b were developed to determine if any environmental parameter was significantly correlated to energy savings, so as to produce a possible bias of the results due to the fact that the frame house has an east elevation (with no windows) exposed to the street, while the panel house was located closely between two other houses. The plots of heating energy-use savings against outdoor temperature, solar irradiance, wind speed and relative humidity appeared random, and showed no clear correlations for either monitoring period.

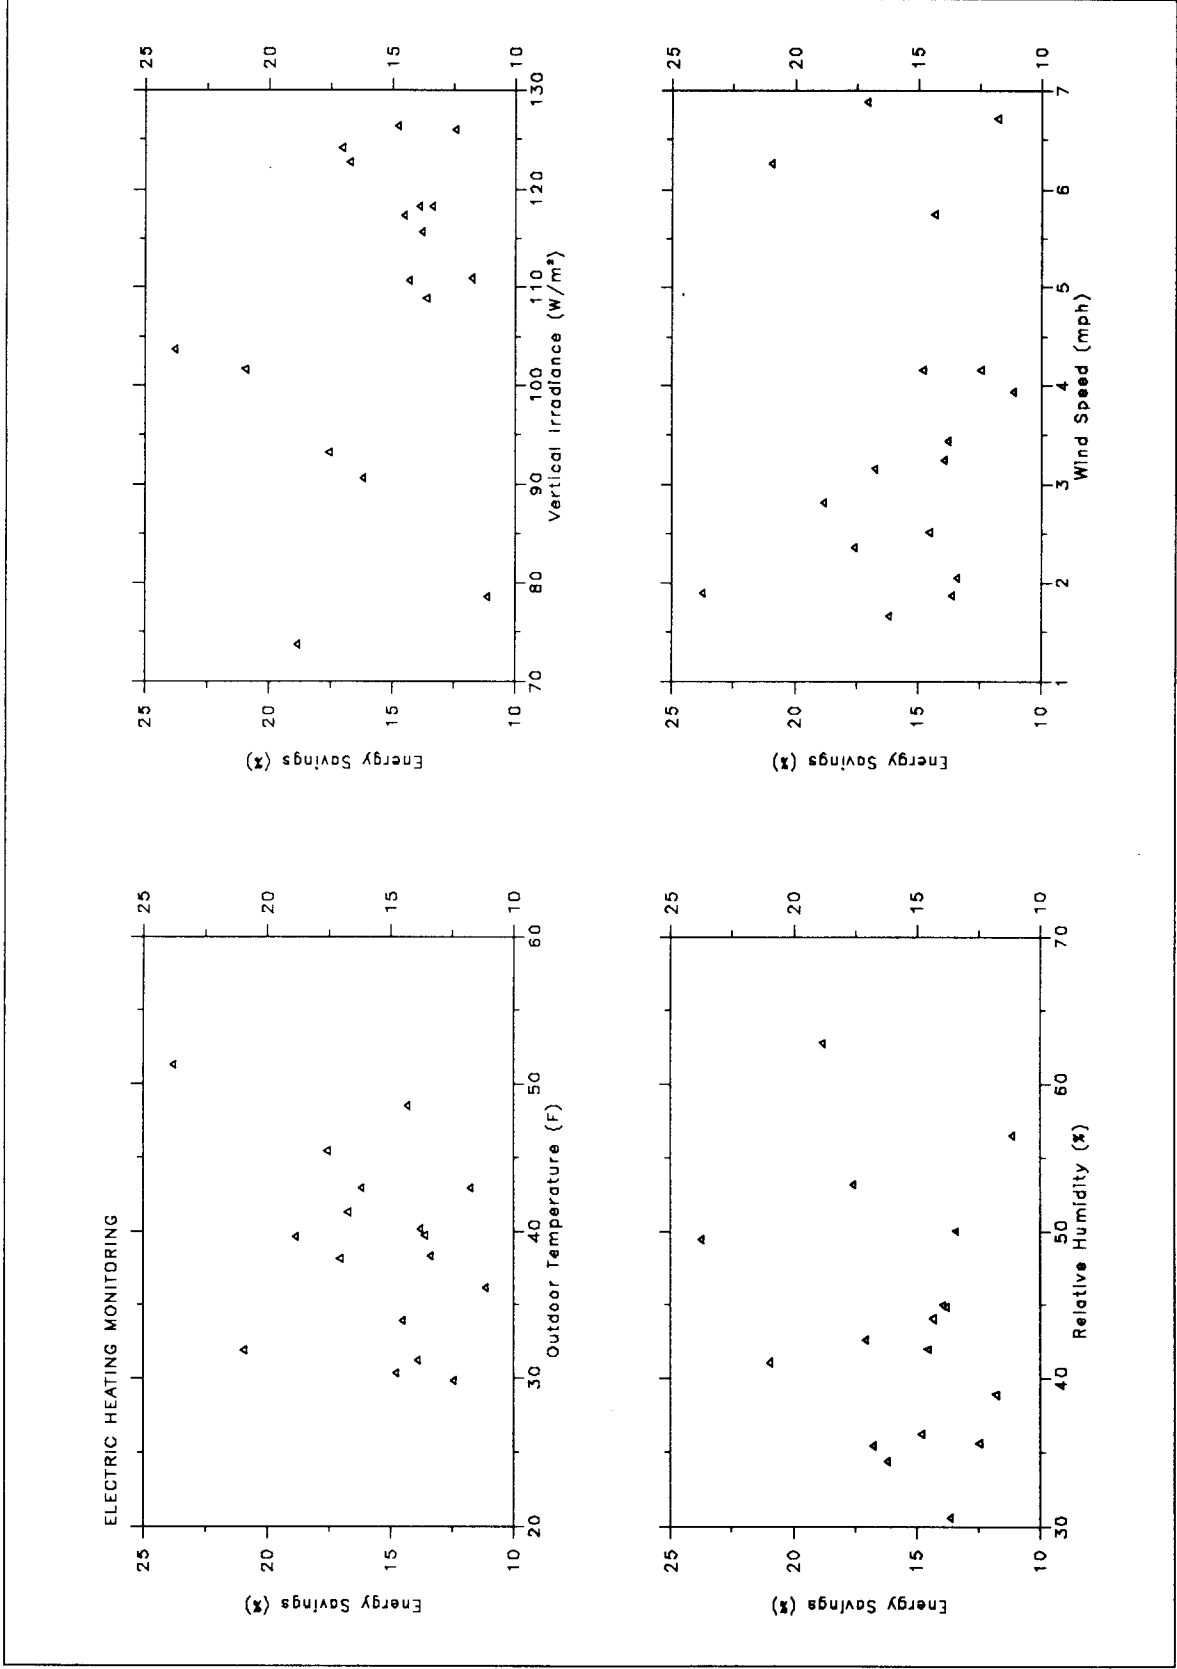

**Figure 8a** Heating energy savings versus outside environmental conditions during electric heating monitoring

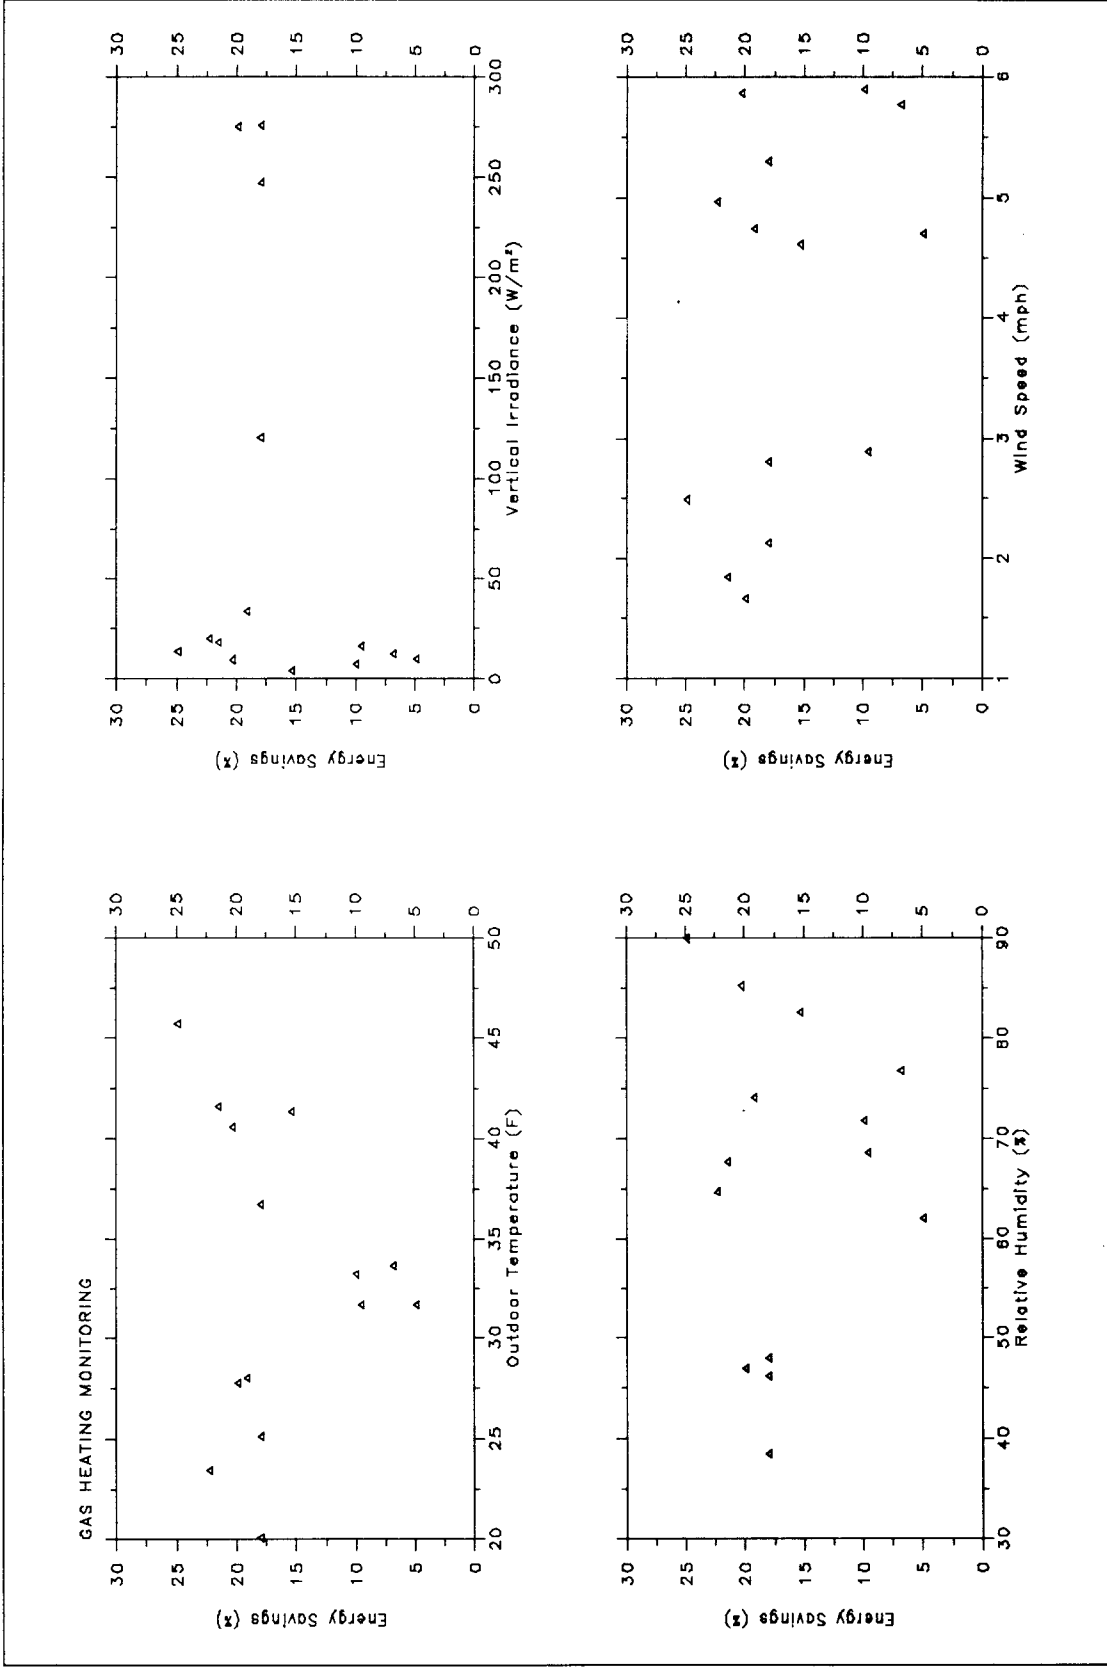

**Figure 8b** Heating energy savings versus outside environmental conditions during gas heating monitoring

Mostly for the readers general information, Figures 9a and 9b give an hourly-averaged time-trace of indoor and outdoor relative humidity for both houses and both monitoring periods. Figures 10a and 10b give the same time-trace for mean radiant temperature; and Figures 11a and 11b give the time-trace for south wall temperature. These plots demonstrate how similarly the two houses performed in terms of interior comfort conditions, and illustrate the validity of the test conditions.

## **Conclusions**

Extensive energy-use monitoring was conducted comparing the building thermal envelopes of a conventional stud-frame house and an industrialized house using stressed-skin insulated core panels for its walls and ceiling. The houses were otherwise identical. By calculation, the two houses had a conductive thermal transmittance within 2% of each other. Measured co-heating data showed the total building load coefficient of the panel house to be 12% lower than the frame house. Monitored heating energy-use data, for nighttime hours only, showed that the SSIC panel house used 12% and 15% less energy than the frame house during electric heating and gas heating, respectively. Monitored energy-use for 24-hour data indicated between 15 and 17% energy savings. A preliminary effort to predict seasonal heating energy savings, using simple regression models and TMY weather data, indicated energy savings ranging between 14 and 20%. More detailed seasonal predictions would require additional effort. In addition to the panel house being more air-tight, there seem to be other factors, which remain unaccounted for, which cause the panel house to use less heating energy. These factors require further investigation.

## **Acknowledgement**

This research was conducted as part of the Energy-Efficient Industrialized Housing Project funded by the U.S. Department of Energy, George James, program manager. The authors thank the Structural Insulated Panel Association, and specifically Frank Baker and Fred Fischer, for their efforts in support of this research. The authors also acknowledge the valuable contributions made by Philip Read of FSEC and Michael Johnston of Dovetail Construction, the builder of both houses.












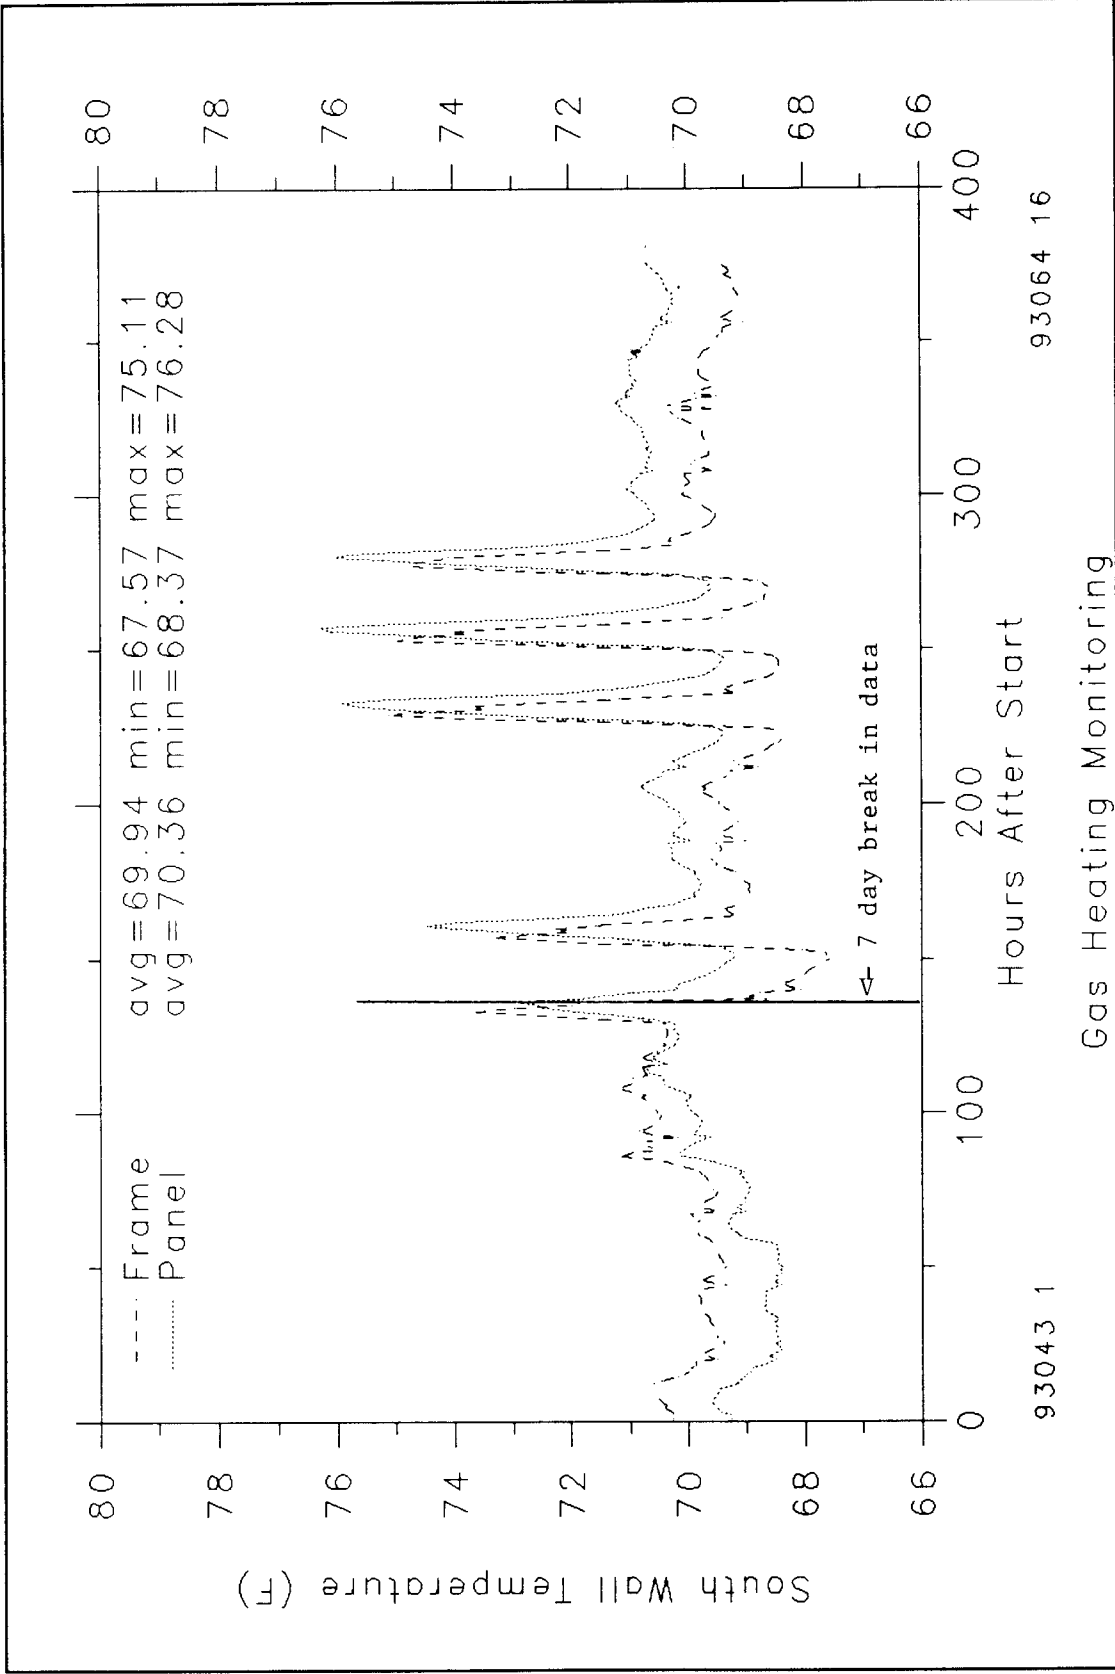

**Figure 11b** Hourly time-trace of inside south wall temperature (over insulated cavity) during gas heating monitoring

## References

- ASHRAE, 1989. *Handbook of Fundamentals*. American Society of Heating, Refrigeration and Air-conditioning Engineers, Atlanta.
- Cummings, James B., John Tooley, Neil Moyer, 1992. "Duct Doctoring: Diagnosis and Repair of Duct System Leaks." Under contract to Florida Energy Office. Florida Solar Energy Center, January.
- Dietz, Russell N., Robert W. Goodrich, Edgar A. Cote, Robert F. Wieser, 1986. "Detailed Description and Performance of a Passive Perfluorocarbon Tracer System for Building Ventilation and Air Exchange Measurements." *Measured Air Leakage of Buildings*. ASTM STP 904, H.R. Trechsel and P.L. Lagus, Eds., American Society for Testing and Materials, Philadelphia, pp. 203-264.
- Lutz, Jim, 1992. "Simulation Software Gets Reality Check." *Home Energy*, Sep/Oct, pp. 21.
- Pratt, R.G., C.C. Conner, E.E. Richman, K.G. Ritland, W.F. Sandusky, M.E. Taylor, 1989. "Description of Electric Energy Use In Single-Family Residences In The Pacific Northwest." Pacific Northwest Laboratories, Richland, and Bonneville Power Administration, Portland. End-use Load and Consumer Assessment Program (ECLAP). July.
- Subbarao, K, J.D. Burch, C.E. Hancock, A. Lekov, J.D. Balcomb, 1988. "Short-Term Energy Monitoring (STEM) Application of the PSTAR Method to a Residence in Fredricksburg, Virginia." Solar Energy Research Institute, SERI/TR-254-3356.